

NOTES

DIMENSIONS SHOWN FROM SOIL HOLES ARE BASED UPON MEASURING 2 FEET IN FROM THE DEEP END OF THE SOIL HOLE.

ORIENT THE DRAINFIELD IN RELATION TO THE TREES, SOIL HOLES, AND PHYSICAL FEATURES SHOWN (AT ALLOWABLE TRENCH DEPTHS SHOWN IN TYPICAL TRENCH SECTION A-A).

USE ELBOWS AND BENDING OF PIPE (200' MIN. RADIUS) IN ORDER TO MAINTAIN THE PVC LATERAL IN THE CENTER OF THE TRENCH. ALSO USE #4 REBAR BENT INTO AN INVERTED "U" AND DRIVE INTO THE GROUND TO SECURE THE LATERALS AS NEEDED.

ANY CONTOUR LINES AND ELEVATIONS SHOWN ARE BASED UPON AN ASSUMED DATUM.

ALL TREES WITHIN 8 FEET OF THE DRAINFIELD SHALL BE REMOVED. IT IS RECOMMENDED TO REMOVE ALL TREES WITHIN 10 FEET OF THE DRAINFIELD.


PROVIDE TRAFFIC BARRIERS AROUND THE INITIAL AND RESERVE DRAINFIELD AREAS SATISFACTORY TO THE HEALTH DEPARTMENT.

LEGEND

- 1 EXISTING BACKHOE SOIL HOLE OBSERVED BY CDS ON 7/25/07.
- S.T. PROPOSED SEPTIC TANK, SEE DETAIL FOR SPECIFICATIONS.
- P.C. PROPOSED PUMP CHAMBER, SEE DETAIL FOR SPECIFICATIONS. P.C. CAN BE LOCATED UP TO 950 FEET AWAY FROM (PETP LENGTH) AND UP TO 115 FEET LOWER IN ELEVATION THAN LAT. 1.
- SCH. 40 PETP PROPOSED SCHEDULE 40 PVC PRESSURE EFFLUENT TRANSPORT PIPE. SEE GENERAL CONSTRUCTION NOTES FOR FURTHER SPECIFICATIONS.
- 4" GSTP PROPOSED 4" ASTM D3034 PVC GRAVITY SEWAGE TRANSPORT PIPE AT 1% MINIMUM SLOPE. SEE "GSTP" IN GENERAL CONSTRUCTION NOTES.
- TBM 1 TURNING BENCH MARKS (MAPPING CONTROL POINTS), 6" GALVANIZED SPIKE. PROTECT AS MANY OF THESE POINTS AS POSSIBLE FOR RECORD DRAWING MAPPING (AND FIELD STAKING IF REQUIRED).

ACCURACY NOTE

PROPERTY LINES ARE BASED ON INFORMATION PROVIDED BY THE CLIENT, THE RECORD OF SURVEY RECORDED IN VOLUME 30 OF SURVEYS, PAGE 167, RECORDS OF JEFFERSON COUNTY WASHINGTON AND ON JEFFERSON COUNTY ASSESSOR'S MAPS. PHYSICAL FEATURES SHOWN IN RELATION TO PROPERTY LINES ARE BASED ON INFORMATION SUPPLIED BY THE CLIENT. THE LOCATION OF PHYSICAL FEATURES IS BASED ON LOCATION WITH A TOPCON 8205A 5" ROBOTIC TOTAL STATION, HAND COMPASS AND A COMBINATION OF PACING, TAPING, AND MEASURING WHEEL AND ARE NOT BASED UPON AN ACTUAL SURVEY. TOPOGRAPHIC INFORMATION IS TO BE USED FOR SEPTIC SYSTEM PURPOSES ONLY.

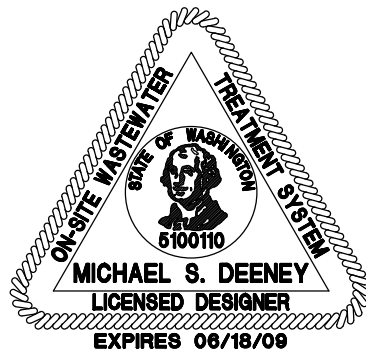

NOTE:
THIS IS A PLANNING DOCUMENT ONLY
NOT FOR CONSTRUCTION UNTIL SEPTIC PERMIT IS APPROVED BY THE HEALTH DEPARTMENT

December 17, 2010 4:38:52 p.m.
Drawing: VOGLEY SEPTIC DESIGN (WEB SITE VER.).DWG.DWG
© CREATIVE DESIGN SOLUTIONS 2008

REVISION	DATE
DRAWN BY: MICHAEL S. DEENEY	
SHEET 2 OF 11	DATE: 8/1/08

SEPTIC SYSTEM, PARCEL #701253005
SITE PLAN
FOR: KIM VOGLEY

25(27-1W)



CREATIVE DESIGN SOLUTIONS
Septic System Designs, Permits, & Inspections
P.O. BOX 2787, PORT ANGELES, WASHINGTON 98362
(800) 395-7296, (360) 457-6353, EMAIL: MIKE@CDS4YOU.COM